


A

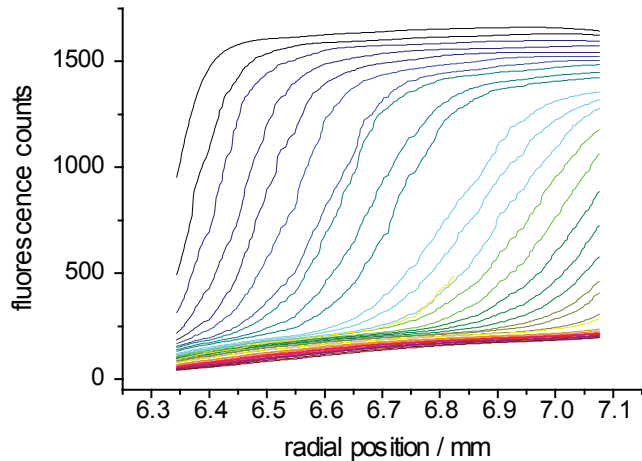

B

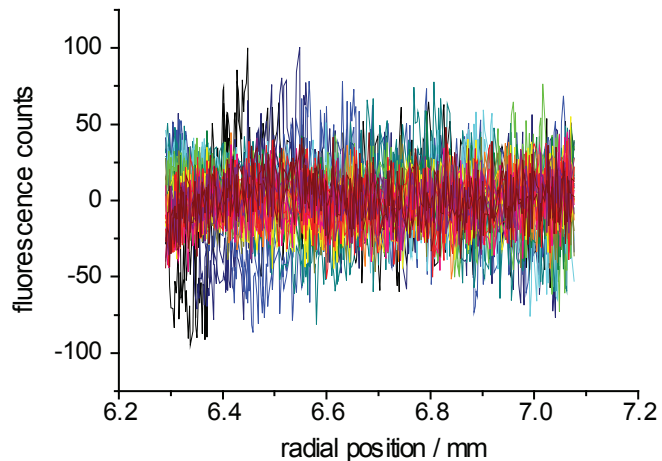


Figure S1. Raw data of analytical ultracentrifugation experiments. A) Traces of fluorescence measurements as function of radial position. The first scans are shown in black, the last scans are shown in red. B) Residual error for fit traces.